work of providing, laying 150 & 100mm dia DI water supply pipeline in place of 75mm/100mm dia corroded CI line in Badama Khan main roads and cross roads and surrounding areas to reduce contamination and freequent leak under VV Puram Service station of AEE SW2 Sub-Division area:

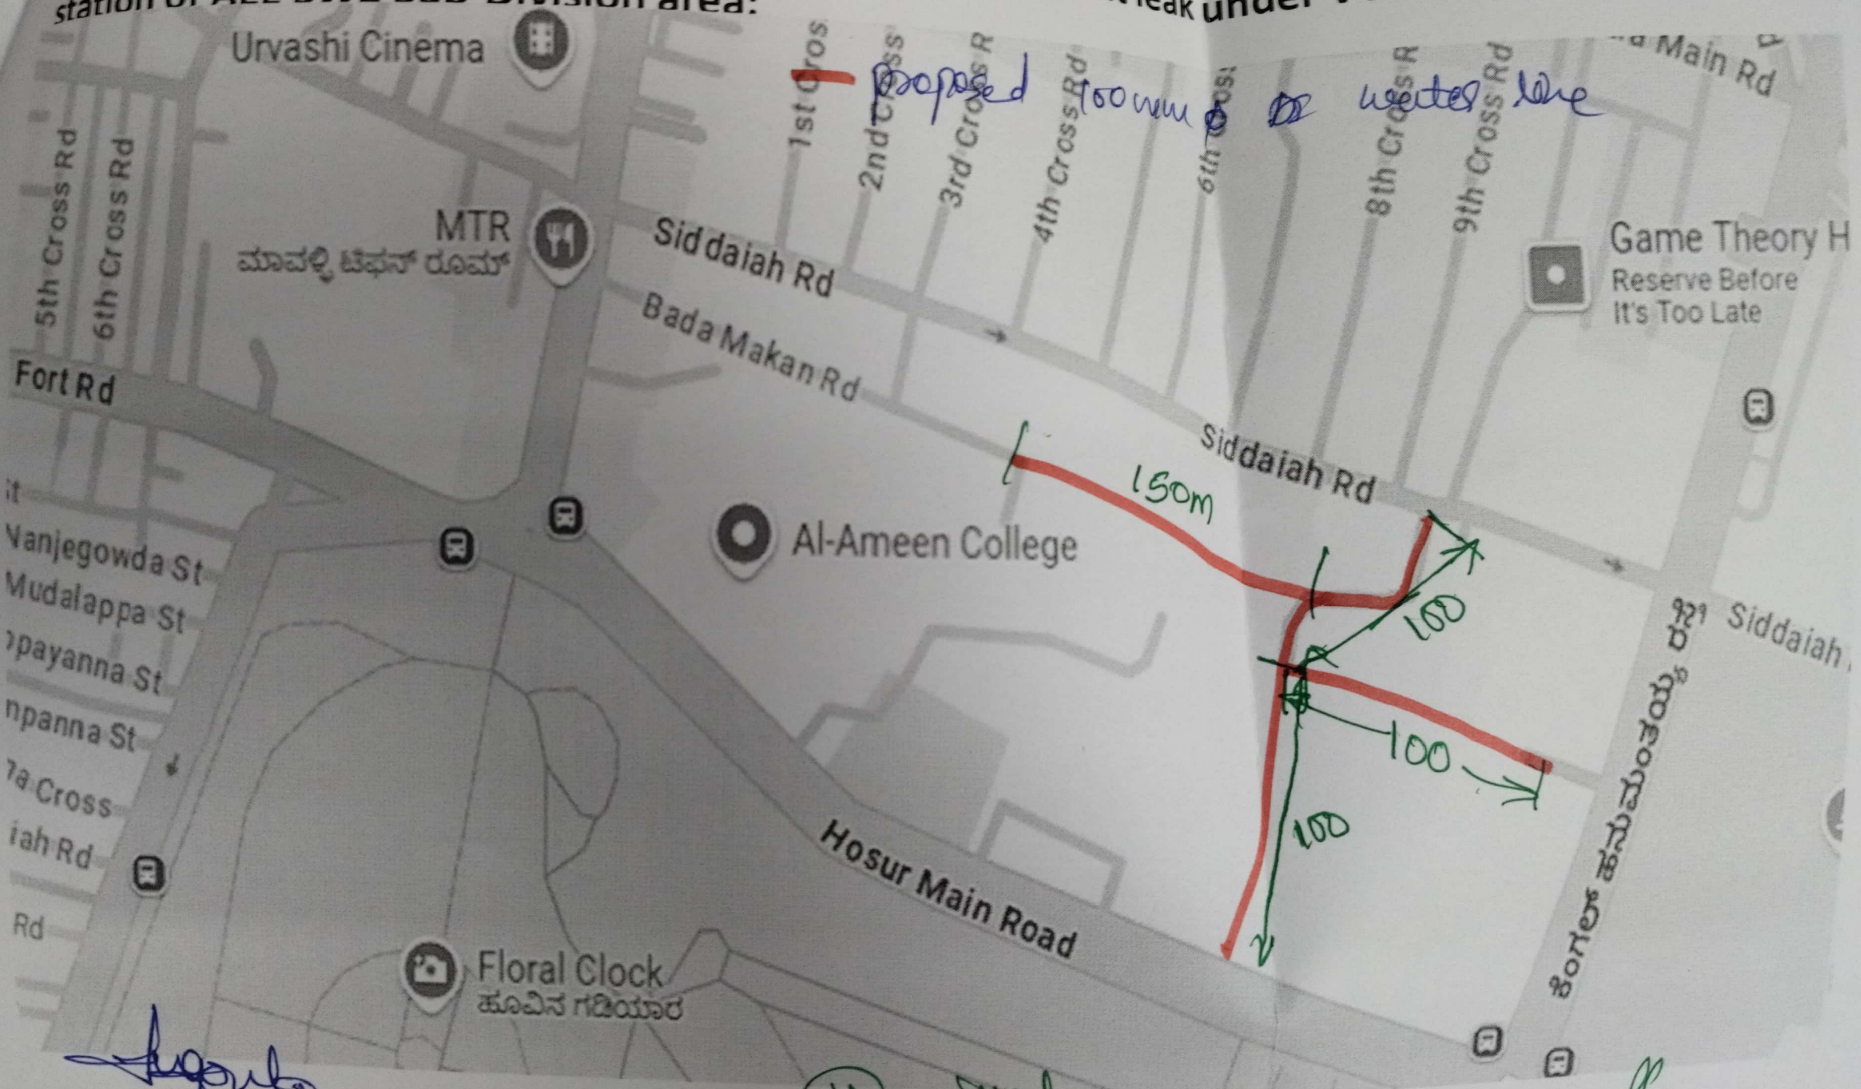

JE UJR

AEESW-2

EESW-1

Scanned with OKEN Scanner

work of providing, laying ~~150~~ & 100mm dia DI water supply pipeline in place of 75mm/100mm dia corroded CI line in Badama Khan main roads and cross roads and surrounding areas to reduce contamination and freequent leak under VV Puram Service station of AEE SW2 Sub-Division area:

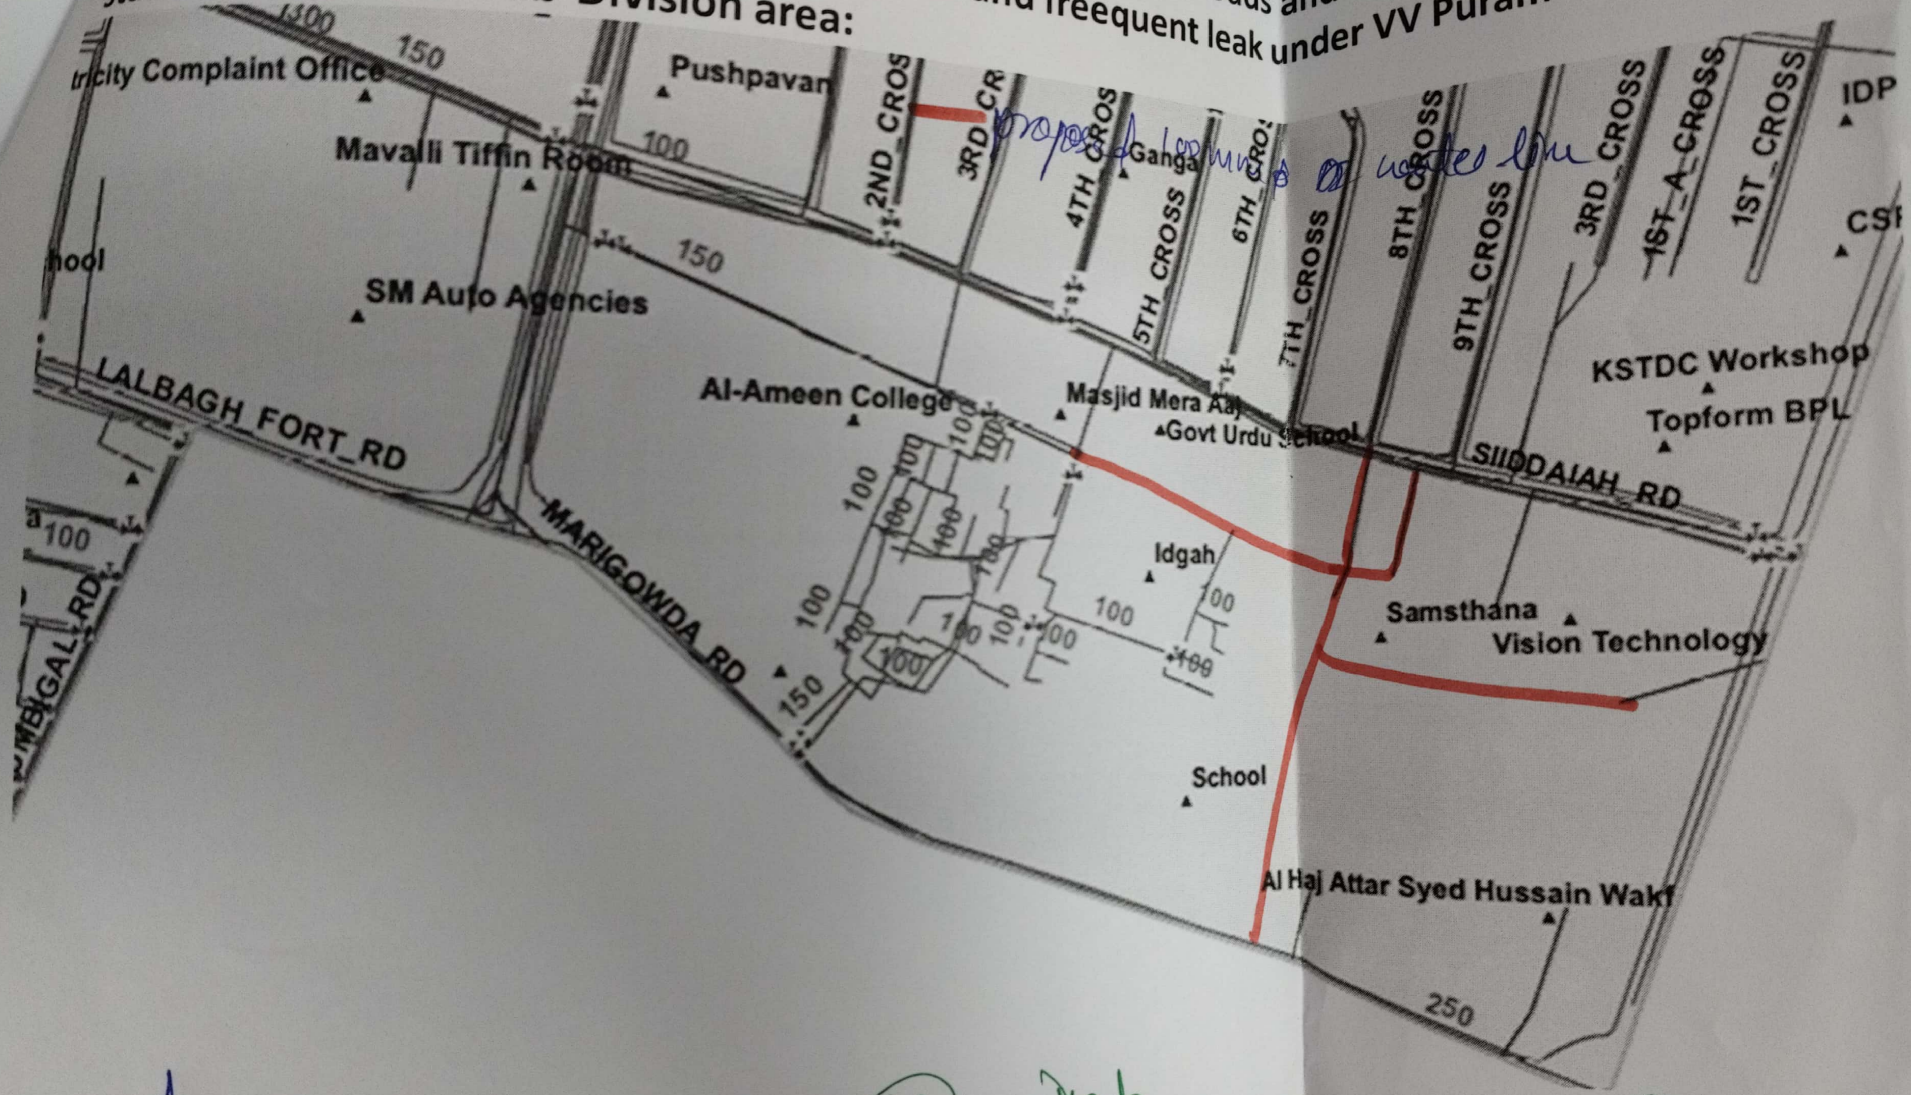

JE JJR

AEESW-2

EESW-1

Scanned with OKEN Scanner